

Safety instructions

The unit may only be opened by an electrician and installed according to the circuit diagram on the unit or in these instructions. Observe existing safety instructions.

To satisfy the requirements of protection class II, corresponding installation measures are required.

This independently installable electronic device is exclusively for controlling the temperature in dry, enclosed rooms with normal surroundings. This device is in conformance with EN 60730 and functions according to operating mode 1C.

Damage to the device, fire or other hazards may arise if these instructions are not followed. These instructions are a component part of the product and must remain with the end customer.

Structure of the device

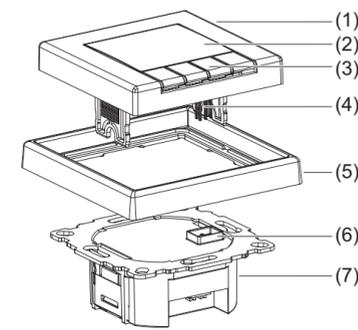


Fig. 1: Layout of the temperature controller

- (1) Controls
- (2) Display
- (3) Control buttons
- (4) Plug-in contacts
- (5) Design frame (not including delivery)
- (6) Socket for the plug-in contacts
- (7) Use

Function

Correct use

- Measuring and controlling the room temperature
- Measuring and controlling the floor temperature
- Room temperature control via floor heating with a limiting function (for example in conjunction with tiled stoves)
- Can be used for "heating only" or "cooling only"
- Installable in a box in conformance with DIN 49073
- Only for use in dry, enclosed rooms

Product characteristics

- Large display with backlighting
- Text display for self-explanatory operation
- Programmable even when the controls are removed
- Different user languages can be selected
- Real-time clock with automatic switchover to/from daylight savings time
- Internal temperature sensor
- An external remote sensor can be connected
- Three selectable and adjustable time temperature programs for automatic mode
- A maximum of nine operating times per day (the setting can also be terminated after a specific operating time)
- Can be individually programmed every day, or a block of operating times can be set: workdays/non-workdays, all days the same
- Can be manually adjusted at any time
- "Vacation" mode with the entered date (from/to)
- "At-home" mode (present)
- Short-time timer ("party function")
- Optimum start" function (the temperature is reached at the set time)
- Protection against frost

- Display of energy consumption for electric heating systems
- Pulse width modulation (PWM) or two-point control system
- Adjustable cycle time (PWM), hysteresis and minimum on/off time (two-point)
- Switch on delay, such as for burners (with two-point control)
- Adaptation to valves normally open or closed
- Valve protection (as a room temperature controller with and without a limiting function)
- Resetting separate from user and installer settings

Description of functions

The programmable temperature controller automatically controls the room or floor temperature depending on the time and day of the week. The automated program can be interrupted at any time by manual entries.

The temperature controller has three selectable programs for heating which can be adapted to your individual comfort. The controller is equipped with an internal sensor for measuring the room temperature. In addition, an external remote sensor can be connected, for example to measure the floor temperature. The temperature controller compares the measured temperature with set values. If the temperature falls below the current setting, the heating system is turned on.

The control method depends on the type of heating and is determined by the installer:

- Room temperature controller:** The heating is turned on when the room temperature falls below the set target temperature (measured with an internal sensor or external remote sensor).
- For temperature controller:** The floor heating is turned on when the floor temperature falls below the set target temperature (measured using an external remote sensor).
- Room temperature controller with a limiter** (in conjunction with floor heaters): The room temperature is measured and regulated using the internal sensor. An additional external remote sensor is connected to measure the floor temperature, and a target temperature range for the floor is set. The room temperature control is deactivated when the floor temperature is outside of this range. If temperature falls below this range, the heater is turned on, and if the temperature is above this range, the heater is turned off independent of the current room temperature.

Operation

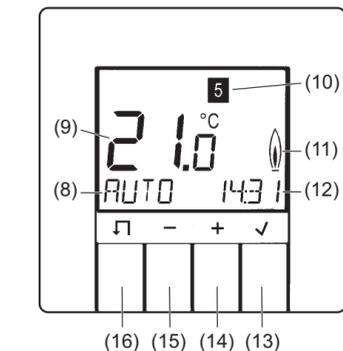


Fig. 2: Default display

- (8) Function display (such as the mode)
- (9) Large display (such as the current temperature)
- (10) Day of the week display (1 = Monday ... 7 = Sunday)
- (11) Heating mode display
- (12) Display (such as the current time)
- (13) button (info/OK)
- (14) button
- (15) button
- (16) button (menu)

Basic information

Four buttons below the display are used to operate the temperature controller (Fig. 2, items (13) to (16)). In the menu, you can activate operating modes, adapt programs and make settings. If a button is not pressed for more than three minutes, the unit automatically switches back to the previous function and the default display (Fig. 2). Program 1 and AUTO mode are the preselected defaults; see "Default programs" and "Modes and setting menus (overview 1)".

Programming when the controls are removed

The unit can also be programmed when the controls are removed. The current temperature is not displayed, the "heating mode" display flashes, and the display is not illuminated. If a button is not pressed for more than three minutes, the display goes dark.

Display information on the current mode

- To go to the default display when the controls are removed and the display is dark, press any button.

- Press in the default display.

Information on the current mode/setting is displayed in the form of a marquee.

- Return to the default display by pressing .

Selecting modes and setting menus

- Press in the default display. MENU briefly appears in the function display (8). A help text as a marquee appears at the bottom edge of the display.

Use the / buttons to switch to the desired mode/setting.

- Select the desired mode/setting by pressing .

Another menu opens depending on the mode/setting.

- Go back to the last display/setting by pressing .

- Return to the default display by pressing several times.

Manually adapting the target temperature

You can always adapt the target temperature in modes AUTO, MAN and TIMER.

- In the default display, press or .
- The current target temperature flashes.
- Set the desired temperature by pressing /.
- Accept the displayed temperature by pressing .
- The device returns to the default display.

Turning off the controls

- In the default display, press the button for 10 seconds.

FIRST "MENU" appears in the display. After 10 seconds, the device switches to the default display and "OFF" appears.


- Turn the controls back on by selecting a mode.

Default programs

The controller offers three default time/temperature programs (full-day settings). These full-day settings depend on the selected heating mode (installer settings, H1) and can be selected by the user and adapted to individual heating preferences (user settings, G1 and G2). The factory setting is program 1. The default time/temperature programs are illustrated in the following in sections in graphs and tables.

A specific example is used (room temperature controller) for program 1 to explain the full-day settings.

Programs for room temperature controller with and without a limiting function

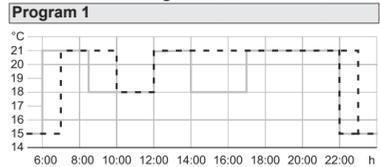


Switching time	Mon – Fri		Sat – Sun	
	Time of day	T °C	Time of day	T °C
1	06:00	21.0	07:00	21.0
2	08:30	18.0	10:00	18.0
3	12:00	21.0	12:00	21.0
4	14:00	18.0	14:00	21.0
5	17:00	21.0	17:00	21.0
6	22:00	15.0	Sat, 23:00 Sun, 22:00	15.0

Table 1:

Full-day settings for program 1, room temperature controller


Program with six switching times. "Comfortable temperature" 21 °C, temperature lowered to 18 °C in the morning and afternoon of work days (absent) and lowered daily at night to 15 °C.

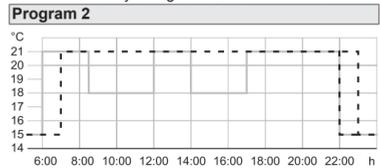

Switching time	Mon – Fri		Sat – Sun	
	Time of day	T °C	Time of day	T °C
1	06:00	21.0	07:00	21.0
2	08:30	18.0	Sat: 23:00 Sun: 22:00	15.0
3	12:00	21.0		
4	14:00	18.0		
5	17:00	21.0		
6	22:00	15.0		

Table 2:

Full-day settings for program 2, room temperature controller

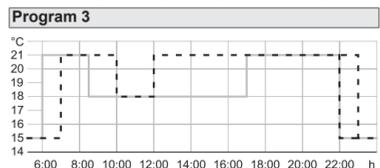


Switching time	Mon – Fri		Sat – Sun	
	Time of day	T °C	Time of day	T °C
1	06:00	21.0	07:00	21.0
2	08:30	18.0	10:00	18.0
3	17:00	21.0	12:00	21.0
4	22:00	15.0	Sat, 23:00 Sun, 22:00	15.0

Table 3:


Full-day settings for program 3, room temperature controller

Programs for the floor temperature controller

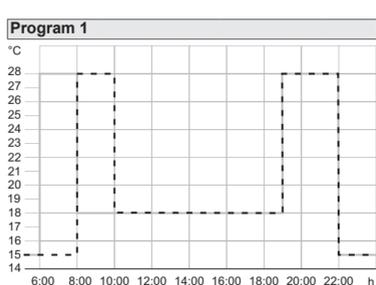


Switching time	Mon – Fri		Sat – Sun	
	Time of day	T °C	Time of day	T °C
1	06:00	28.0	08:00	28.0
2	08:00	18.0	10:00	18.0
3	19:00	28.0	19:00	28.0
4	22:00	15.0	22:00	15.0

Table 4: Full-day settings for program 1, floor temperature controller

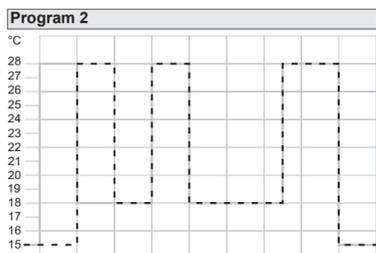

Switching time	Mon – Fri		Sat – Sun	
	Time of day	T °C	Time of day	T °C
1	06:00	28.0	08:00	28.0
2	08:00	18.0	10:00	18.0
3	12:00	28.0	12:00	28.0
4	14:00	18.0	14:00	18.0
5	19:00	28.0	19:00	28.0
6	22:00	15.0	22:00	15.0

Table 5: Full-day settings for program 2, floor temperature controller

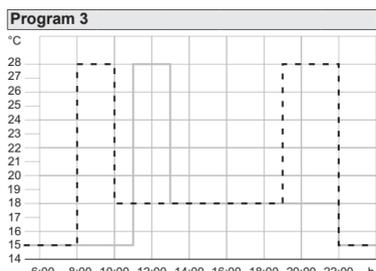

Switching time	Mon – Fri		Sat – Sun	
	Time of day	T °C	Time of day	T °C
1	11:00	28.0	08:00	28.0
2	13:00	18.0	10:00	18.0
3	22:00	15.0	19:00	28.0
4			22:00	15.0

Table 6: Full-day settings for program 3, floor temperature controller

Select program (G1)

- The factory setting is program 1.

The device is in the default display.

Press the button.

The help text "MENU..." appears at the bottom edge of the display.

- Press / to select the settings menu USER SETTINGS and confirm with .

G1 - PROGRAM SELECT ONE appears.

Press the button.

The number of the active program flashes.

- Press / to select the desired program (1 ... 3) and confirm with .

G1 - PROGRAM SELECT ONE appears.

The selected program is now active.

Adapting the program (G2)

The default programs can be adapted to individual heating comfort. A maximum of 9 switching times/ intervals per day are possible. All adaptations affect the active program. When you switch to new program, the adaptations are not saved; that is, any adaptations made to a default program must be reconfigured.

The desired program is active (G1), and G1 - PROGRAM SELECT ONE appears.

- Press the button.

G2 - EVENT SETTING appears.

- Press to select menu item G2.

DAY is displayed, and the day of the week display (10) flashes.

The numbers correspond as follows: 1 Monday, 2 Tuesday... 7 Sunday.

- With the exception of individual weekdays, switching times can also be set for blocks of days 1-5, 6-7, 1-7.

- Press / to select the desired day/block of days, and confirm with .

The temperature display (9) for the first switching interval of the day flashes.

- Press / to set the desired temperature and confirm with .

The starting time of the switching interval flashes.

- Press / to set the desired start time and confirm with .

The ending time of the switching interval flashes.

- Press / to set the desired ending time and confirm with .

The first switching interval is now set. The temperature display for the second switching interval flashes.

If needed, additional temperatures and switching times can be set using the same procedure. The number of the switching interval is displayed in the bottom line of the display in front of the switching times. The respective end time in the display becomes the start time of the next interval. Each switching time can be decreased to the previous time or to 00:00, and increased to a maximum of 23:50. If ->>> flashes in the display, the following switching time falls within the next weekday.

- Press to go to the first start time of the next day of the week.

- Press / to create a different switching interval.

If all 9 switching times of the day are already assigned, the program automatically jumps to the next day of the week. You can delete a switching interval indirectly by increasing the previous interval. Repeatedly press to leave menu item G2 - EVENT SETTING. The settings take effect.

Main menu

Modes and setting menus (overview 1).

To follow is an overview of the modes and setting menus within the main menu.

AUTO
Automatically control the room temperature according to the time and temperature settings of the selected program. Adapt the temperature to the next to switching time (see "Manually adapt the target temperature").
A minus sign following the "AUTO-" mode in the display indicates that the target temperature has been adapted and that it deviates from the temperature saved in the time/temperature program until the next switching time.

MAN
Manually control the room temperature independent of the time to the value set here (see "Manually adapt target temperature".)

TIMER
Short-time timer to specify the room temperature for a set number of hours ("Party function").

- Press / to set the hours and confirm with .

- Press / to set the temperature and confirm with .

The display (12) shows the number of remaining hours.

Subsequently adapt the temperature for the remaining hours (see "Manually adapt the target temperature").

HOLIDAY
Specify a room temperature for a set time interval with the start and end date of vacation. Until vacation starts, the currently set mode is active: AUTO, MAN, TIMER, AT HOME. Start HOLIDAY when the start date is reached.

- Set the year, month, day for the first and last day of vacation with / and confirm with .

- Press / to set the temperature and confirm with .

"V." and the date of the last day of vacation is shown in the displays (8) and (12).

AT HOME

Control the temperature independent of the day of the week according to the time and temperature information in the selected program (full-day setting). The program defaults correspond to the current day program of Monday.

- Set the temperature and switching times with / and confirm with O.

Activate the mode "AT HOME" by confirming the last switching time. The function display (8) shows "HOME".

USER SETTINGS

Open the menu for the user settings.

The display (9) shows the menu ID G1.

- To select the desired submenu, see "User settings".

INSTALLER SETTINGS

Open the setting menu for the installer.

The display (8) shows the menu ID H1.

- To select the desired submenu, see "Installer settings".

Overview 1: Modes and setting menus

Select the desired mode/setting menu

The device is in the default display.

- Press the button.

The help text "MENU..." appears at the bottom edge of the display.

- Press the buttons / until the desired menu item (mode or setting menu) appears.

- Confirm with .

The function is activated in modes AUTO and MAN.

With the other menu items, the device jumps to additional settings (see overview 1).

Temperature management

Universal room temperature controller with display

Art. No.: TR UD .. 231 ..

Operating and installation instructions



ALBRECHT JUNG GMBH & CO. KG

Volmestrasse 1
58579 Schalksmühle, Germany

Telephone: +49 2355 806-0

Fax: +49 2355 806-204

kundencenter@jung.de

www.jung.de

Service Centre

Kupferstr. 17-19

44532 Lünen

Germany

User settings

Overview 2

A marquee at the bottom of the display shows information for an individual menu items identified with G1 to G16.

Depending on the set control procedure, the menu items G11 and G12 are not available.

(The menu displays and set all values are in UPPER CASE, and the **settings are bold**)

G1 PROGRAM SELECT ONE
Choose one of the default time/temperature programs (see "Select program"): 1, 2, 3.
Select the program number with \uparrow/\downarrow , confirm with \checkmark .

G2 EVENT SETTING
Adjust a default time/temperature program (see "Adapt program").
Adjust the days of the week, temperatures, switching times with \uparrow/\downarrow , confirm with \checkmark .

G3 CLOCK SETTING
Set the date and time.
Set the YEAR, MONTH, DAY, HOUR, MINUTE with \uparrow/\downarrow and confirm with \checkmark .

G4 OFF HEATING PERMANENT
Turn off the temperature control:
- YES = Control off
- NO = Control on
Select YES/NO with \uparrow/\downarrow , confirm with \checkmark .
If OFF HEATING PERMANENT = YES is selected, the frost protection is active provided that it has been set by the installer. *see also Installer settings H6 - FROST PROTECTION \neq OFF*
Display function (8): OFF
Turn on the control: Select a function using the menu, or hold \square for 10 s.

G5 SUMMER/WINTER TIME CHANGE
Set whether the switchover from/to daylight savings is automated.
- YES = automated
- NO = not automated
Select YES/NO with \uparrow/\downarrow , confirm with \checkmark .

G6 KEY LOCK
Protect the controller from unauthorized use. Use is not possible when access protection is enabled.
- YES = access protection on
- NO = no access protection
Select YES/NO with \uparrow/\downarrow , confirm with \checkmark .
Remove access protection: Press any button, and when CODE is displayed, set 93 with \uparrow/\downarrow and confirm with \checkmark .

G7 TEMP LIMIT MIN/MAX TEMP
Set the bottom and top temperature to be regulated:
- LOWER TEMP LIMIT:
For the room temperature controller (H1 = ROOM or LIMITER):
5.0°C, 5.5°C ... 30.0°C
For the floor temperature controller (H1 = FLOOR):
10.0°C, 10.5°C ... 40.0°C
- UPPER TEMP LIMIT:
For the room temperature controller (H1 = ROOM or LIMITER):
5.0°C, 5.5°C ... **30.0°C**
For the floor temperature controller (H1 = FLOOR):
10.0°C, 10.5°C ... **40.0°C**
Set the temperatures with \uparrow/\downarrow and confirm with \checkmark .
The controls in the modes AUTO, MAN, TIMER etc. are limited to the temperature range set here.

G8 COSTS /HR OF ENERGY
Enter the estimated energy costs per hour for the room in which the temperature is being controlled: 1, 2, ... **100** ... 999 CENT/HR
If the energy cost meter is to serve as an operating hour meter, set the value COST/h to 100.
Set COST/HR with \uparrow/\downarrow , confirm with \checkmark .
The determined use is displayed under G9.

G9 ENERGY CONSUMPTION TO DATE
Display of the approximate energy consumption in euros (or operating hours) per time period. The current day is included up to the displayed time.
Calculation: Time heat turned on x COST/HR (G8), EURO/2DAYS, EURO/WEEK, EURO/30DAYS, EURO/YEAR.
Select the period for calculating the energy consumption, display it with \pm/\square , go back to the menu with \square .
Reset using INSTALLER SETTINGS (H9)

G10 SET TEMP TO READ
Setting for the target temperature to be shown in the display instead of the current room temperature:
- YES = Target temperature
- NO = Room temperature
Select YES/NO with \uparrow/\downarrow , confirm with \checkmark .

G11 ADJUST TEMP
This menu item is not available when used as a floor temperature controller.
Specify a correction value to be displayed and regulated:
-5.0°C, -4.9°C ... **0.0°C** ... 4.9°C, 5.0°C
Useful adaptations are for example matching calibrated thermometers, or adapting to installation heights or locations that are problematic.
Adjust the correction value with \uparrow/\downarrow and confirm with \checkmark .

G12 NUMBER FOR FLOOR TEMP
This menu item is not available when used as a room temperature controller with/without a limiting function.
Activate the floor temperature display for information (without the unit °C).
- YES = Display the floor temperature
- NO = Display the room temperature
Select YES/NO with \uparrow/\downarrow , confirm with \checkmark .

G13 BACKLIGHT
Set the display lighting:
- SHORT = short time after pressing the button
- OFF = always off
- PERMANENT (only when using a remote sensor)
Select SHORT/OFF or PERMANENT with \uparrow/\downarrow , confirm with \checkmark .

G14 LANGUAGE
Select the languages shown in the display: GERMAN, ENGLISH, DUTCH, FRENCH
Select the LANGUAGE with \uparrow/\downarrow , confirm with \checkmark .

G15 INFO
Display controller type and controller version: TR UD ...
Display the controller version with \uparrow/\downarrow , go back to menu with \square or \square .

G16 RESET USER SETTINGS ONLY
Reset the user settings to the defaults.
The counter ENERGY CONSUMPTION TO DATE is not reset. This is reset by the installer in the menu H9.
- YES = reset
- NO
Select YES/NO with \uparrow/\downarrow , confirm with \checkmark .

Overview 2: User settings

Open the settings menu and make settings
The menu ID G1 appears in the display (9), and PROGRAM SELECT ONE appears at the bottom as a marquee.

Press \uparrow/\downarrow o select the desired menu.

The menu ID and a help text appear at the bottom edge of the display (8) and (12).

Confirm with \checkmark .

The first settable value flashes in the display.

Set the desired value by pressing \uparrow/\downarrow .

Confirm with \checkmark .

The next settable value flashes in the display.

Once all the values are set, the display returns to higher-level and displays the menu ID.